


# J.B. CONCRETE PRODUCTS, INC.

1500 GAL OSI SEPTIC TANK - 1 Piece

DATE:  
Jan. 3, 2008

Drawing I.D.  
ST\_1500\_OSI\_2C\_TS

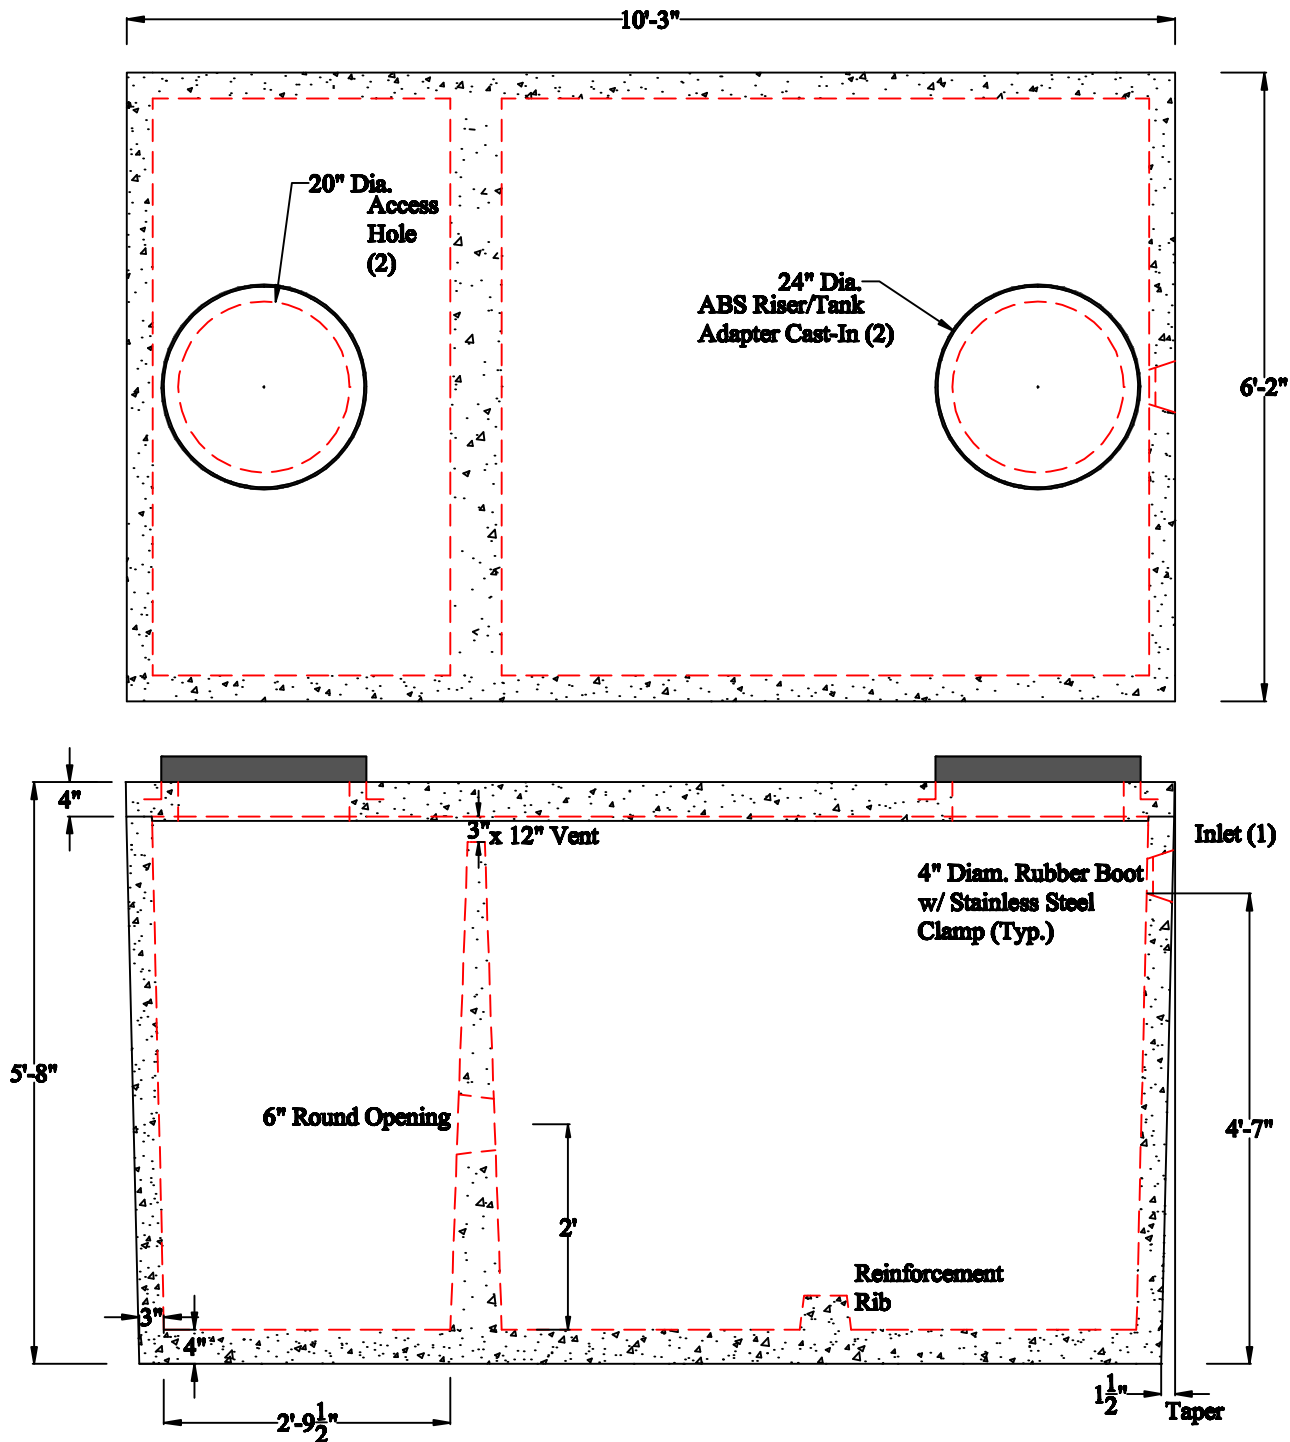

## Notes:

1. CONFORMS TO ASTM C1227.
2. JOINT SEALED WITH BUTYL RUBBER SEALANT.
3. MINIMUM CONCRETE COMPRESSION STRENGTH 5,000 PSI AFTER 28 DAYS.
5. PVC BAFFLE INCLUDED TO BE INSTALLED BY CONTRACTOR
7. VACUUM TESTING AND JOINT WRAP INCLUDED

1 Arch St  
PO Box 387  
Putnam, CT 06260  
(860)928-9365  
F (860)928-9452  
[www.jbconcreteproducts.com](http://www.jbconcreteproducts.com)