
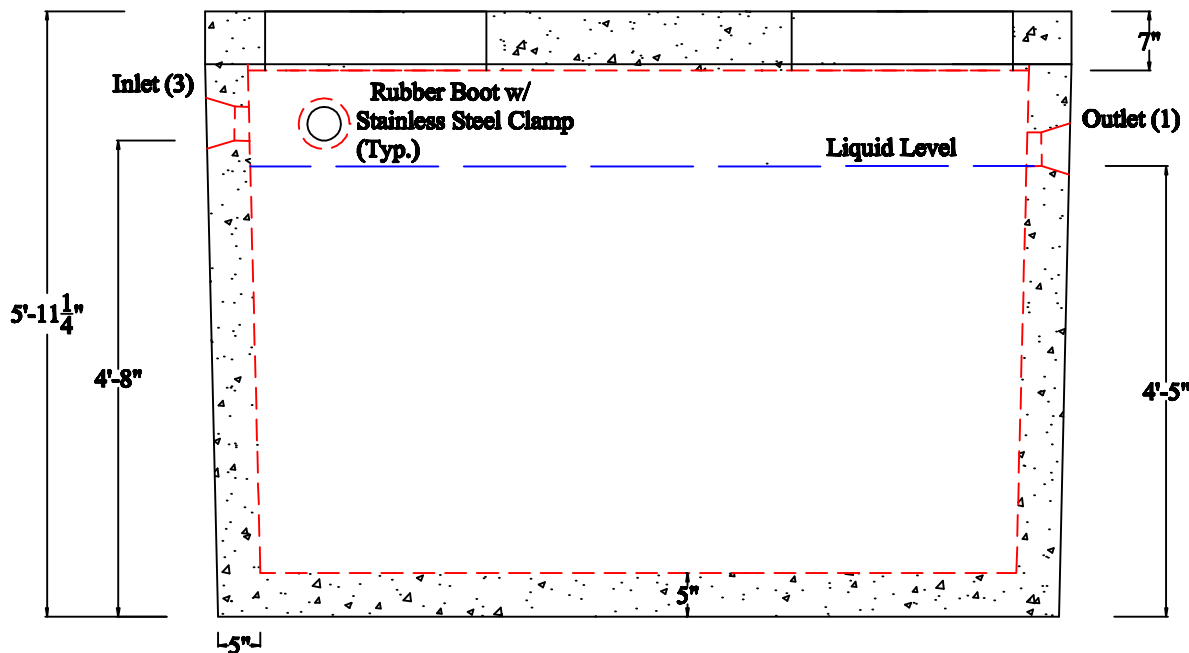


J.B. CONCRETE PRODUCTS, INC.

1000 GAL H-20 PUMP CHAMBER

REV. DATE:
MAR. 1, 2012

Drawing I.D.
ST_1000H20_PC

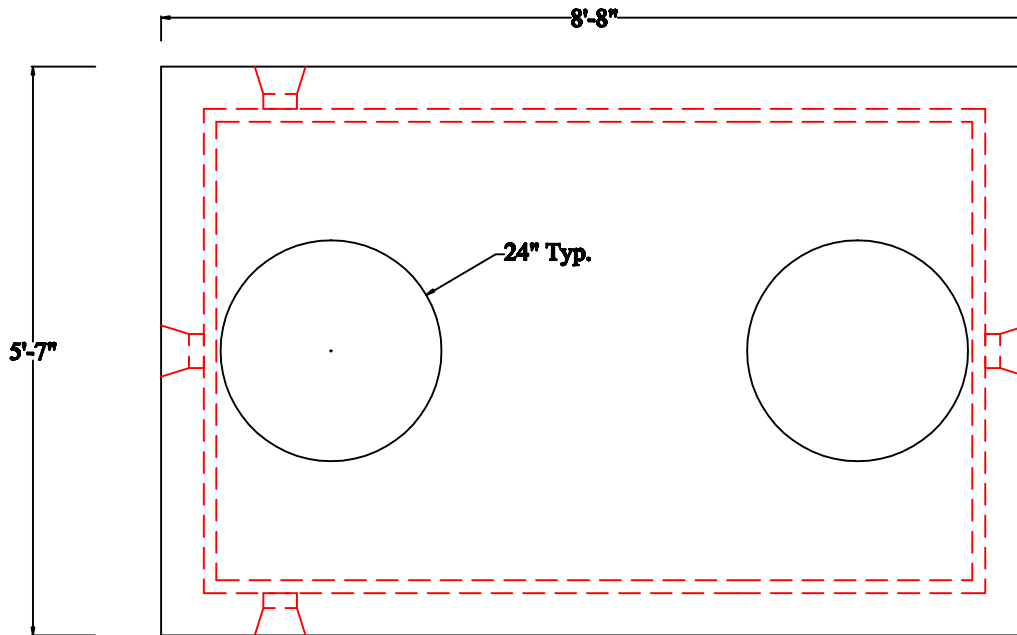

Notes:

1. CONFORMS TO ASTM C1227.
2. JOINT SEALED WITH BUTYL RUBBER SEALANT.
3. MINIMUM CONCRETE COMPRESSION STRENGTH 5,000 PSI AFTER 28 DAYS.
4. STATE APPROVED INLET AND OUTLET PIPE SEALS.
5. PVC BAFFLES INCLUDED TO BE INSTALLED BY CONTRACTOR
6. MEETS H-20 WHEEL LOAD REQUIREMENTS

1 Arch St
PO Box 387
Putnam, CT 06260
(860)928-9365
F (860)928-9452
www.jbconcreteproducts.com